



Water System Operations Manager's Report

Engineering and Operations Committee


Item 7a

October 12, 2020

Current Operational Conditions


- 2020 SWP Allocation is 20%
- SWP blend targets are 0% at Weymouth, Diemer and Skinner plants
- CRA is at a 7-pump flow
- Managing storage based on WSDM principles
- September 2020 deliveries of 136 TAF were 27 TAF lower than September 2019

Ensuring Continued System Reliability

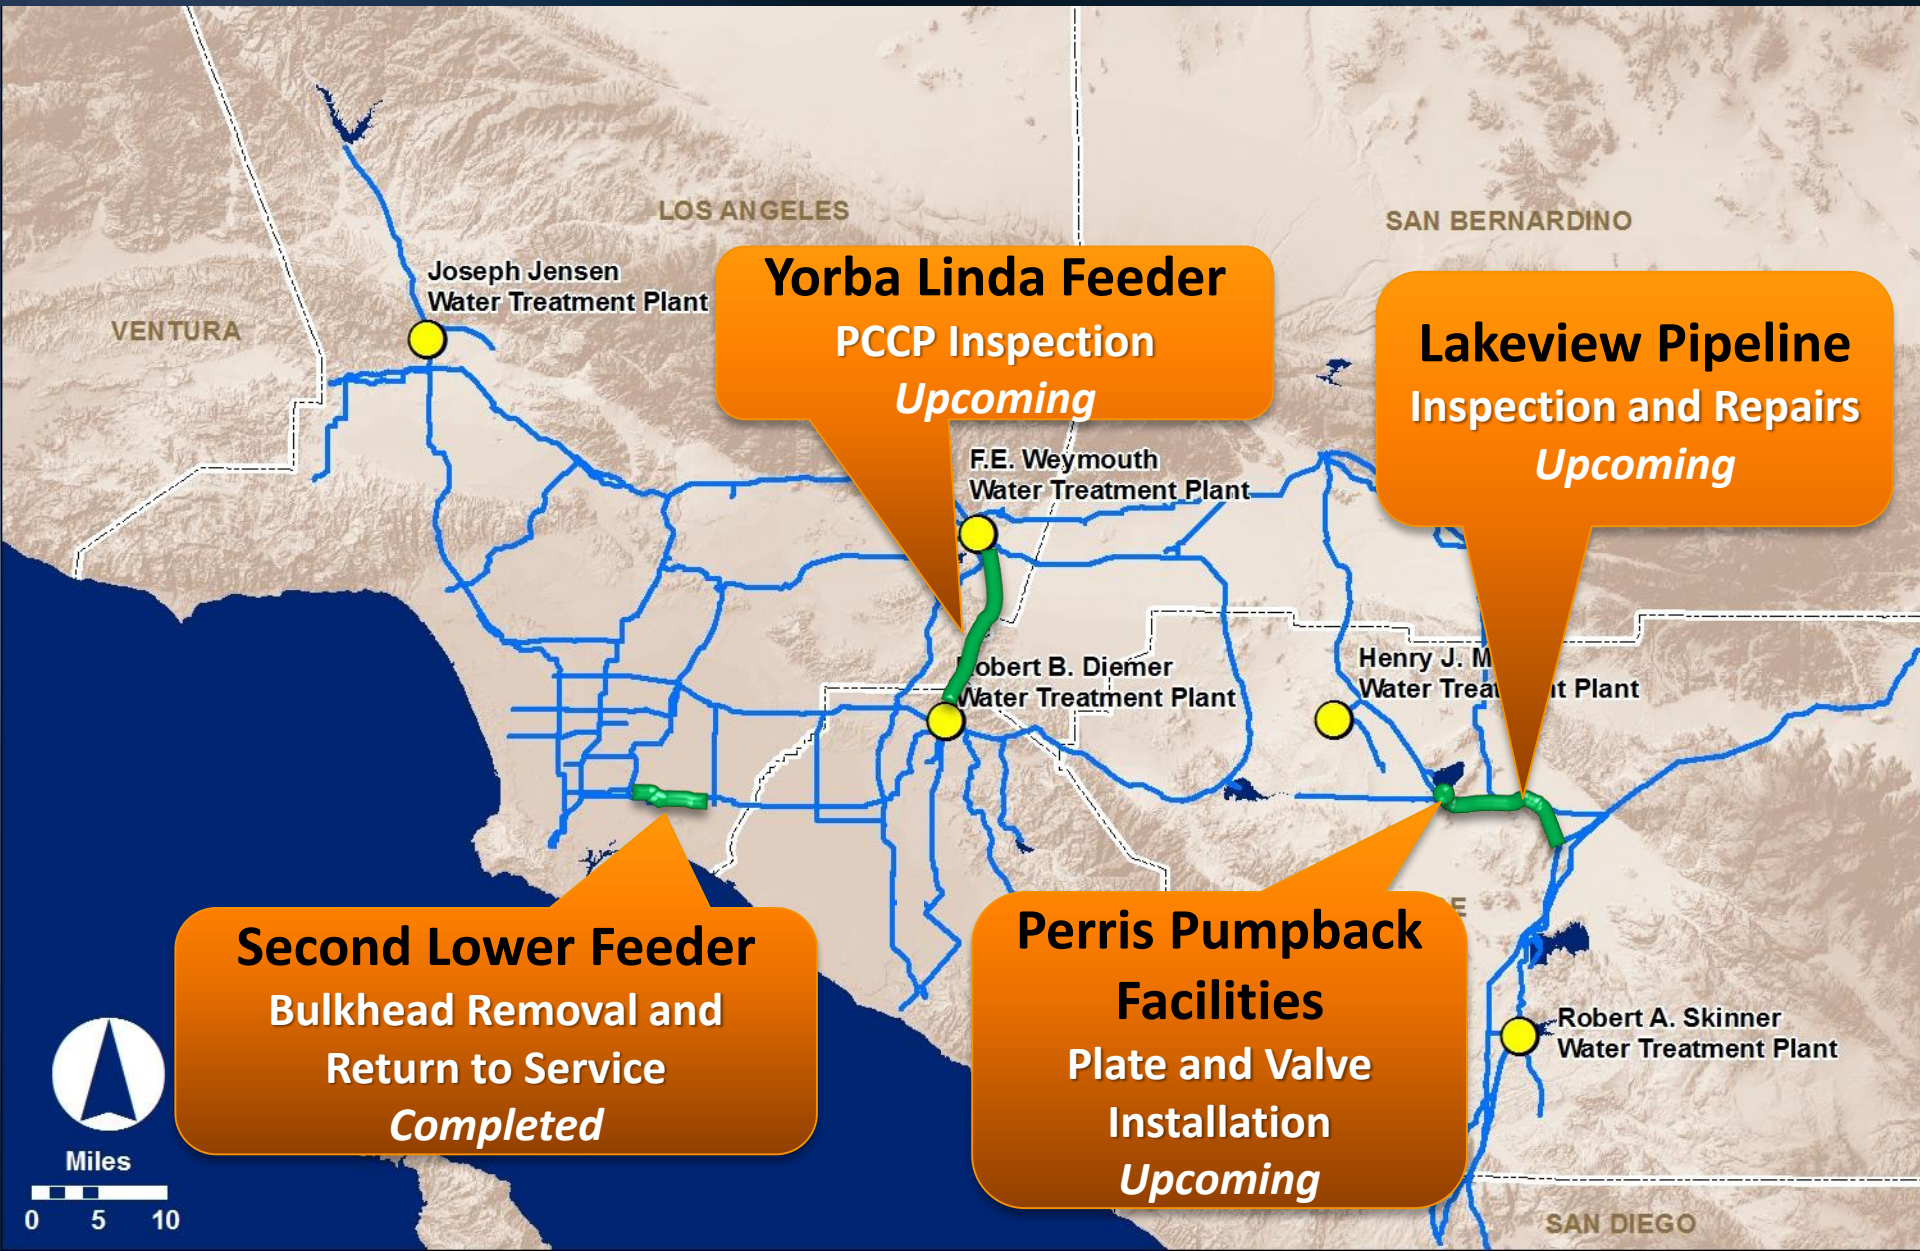

Energy Sustainability Plan

Incorporating Feedback on Draft Plan

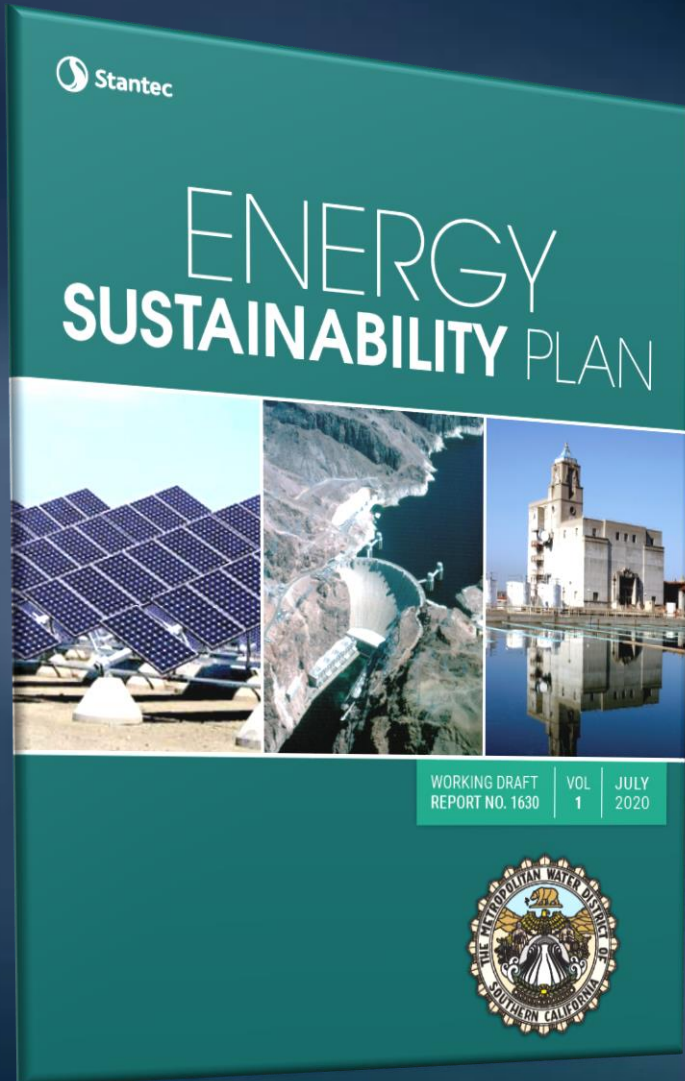

- Draft plan posted on Metropolitan's website
- Comments received and are under review
- Plan will be finalized by the end of 2020

